


UNDERGROUND UTILITIES
 CALL
2 WORKING DAYS
BEFORE YOU DIG
 CALL TOLL FREE 800-362-2764
 OHIO UTILITIES PROTECTION SERVICE

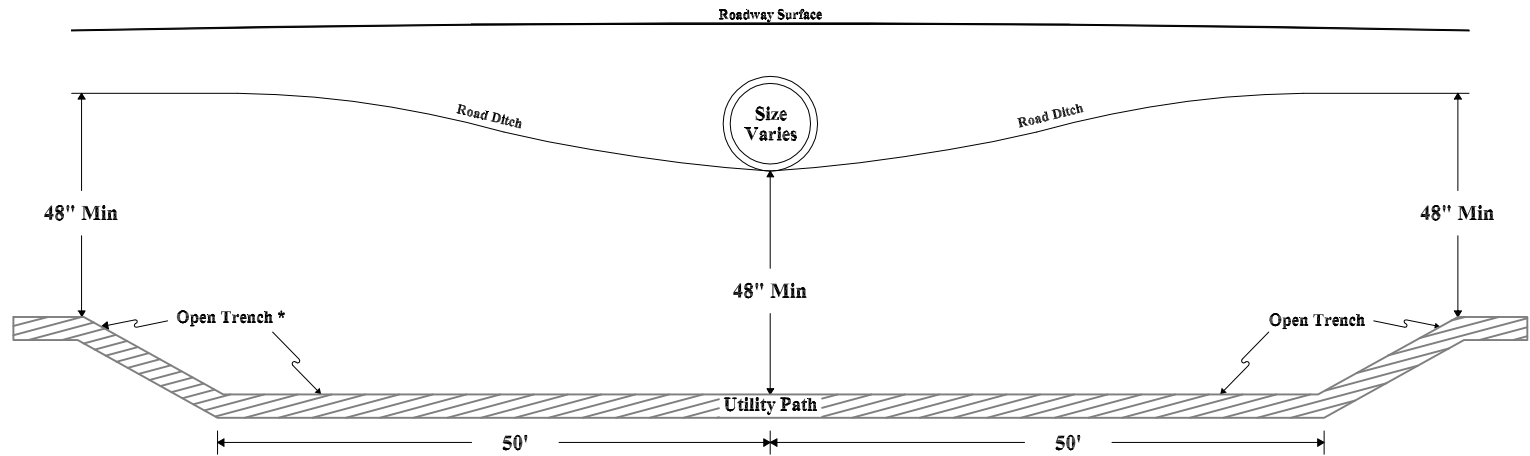

* Trench should have a minimum width of 12"

****In the event during excavation that any agricultural tile(s) or other subsurface drainage tile(s) are damaged, these tile(s) shall be replaced with the same size N-12 plastic or similar approved material, including all couplings.**

****Pickaway County Engineer Inspector shall be contacted to view open trench prior placement of any backfill by the contractor.**

****Trench below tile must be backfilled and compacted in 6" lifts.**

Minimum Standards for Utilities Crossing Road Culverts

Pickaway County Engineer

Dep. Pickaway County Engineer

Approved:

1-23-07

Revised

Minimum Standards for Utilities Crossing Road Culverts

